


► NOTES:

1. WIRE SIZE TO BE DETERMINED BY A LICENSED ELECTRICIAN.

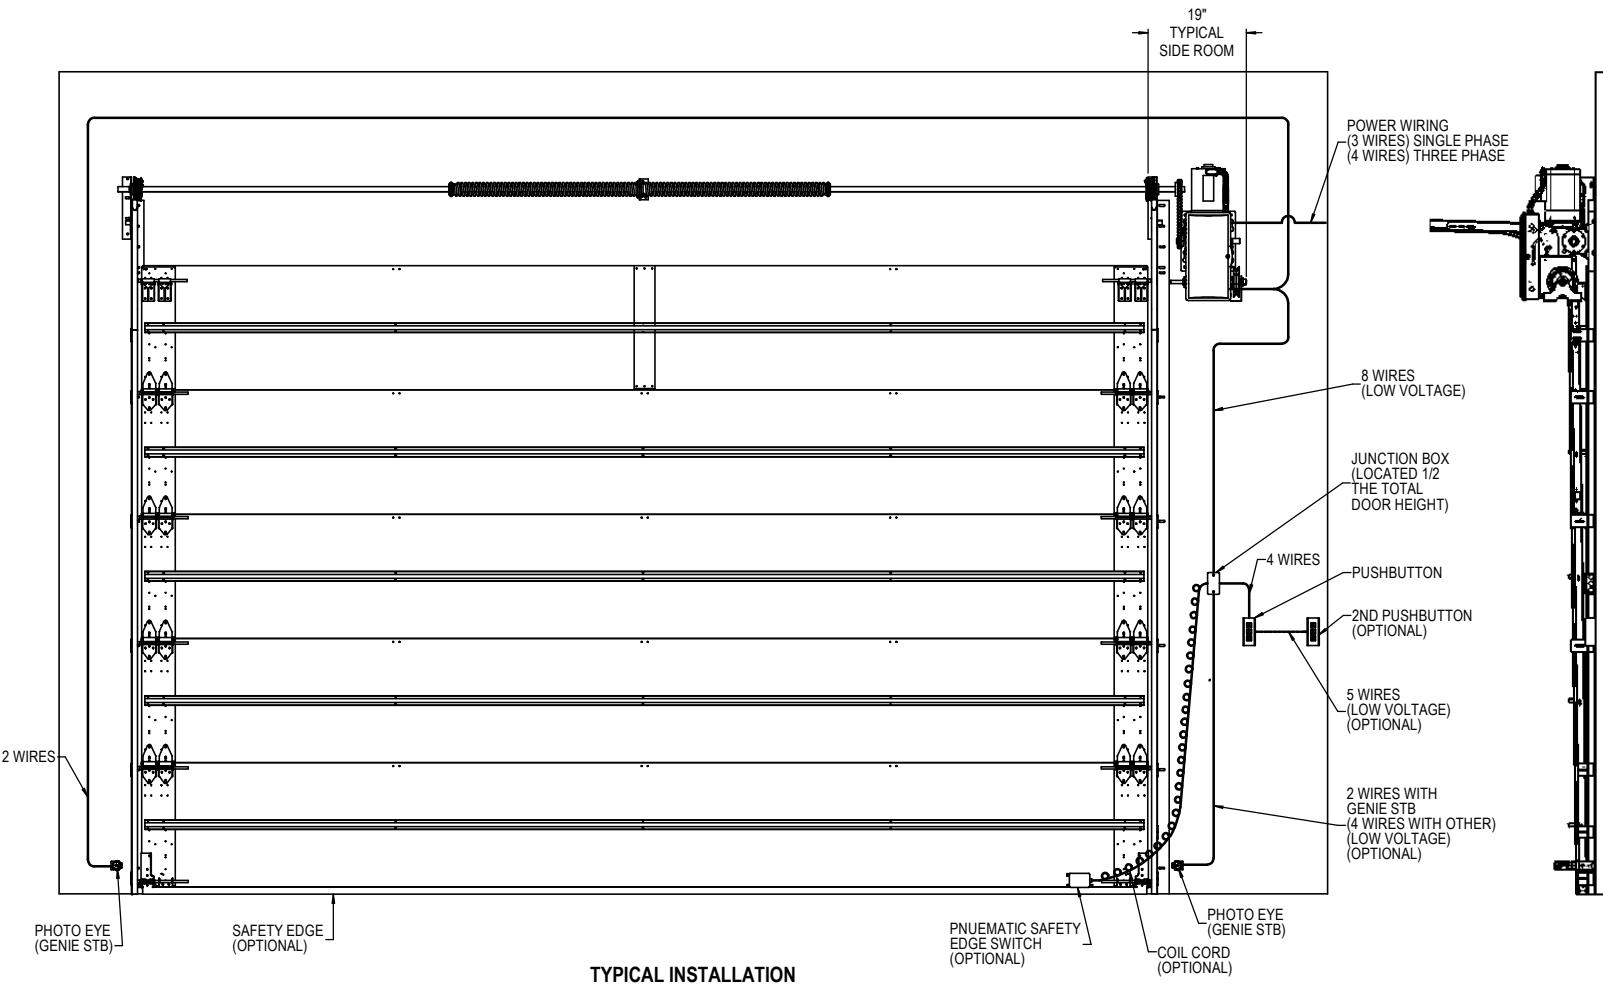

ARCHITECT DOOR NUMBER	QTY	FACTORY ORDER NUMBER	MOUNT TYPE	VOLTS					PHASE		CONTROL STATION		
				115	208	230	460	575	1 PHASE	3 PHASE	3 BTN	KEY SWITCH	EXT. FLUSH 3 BUTTON
			SIDEMOUNT										

112287.0001 REV.-



ELECTRIC OPERATOR: GCL-GH (HEAVY DUTY) (1/2, 3/4, 1 HP)
DOOR TYPE: SECTIONAL
MOUNTING TYPE: SIDEMOUNT (DOOR & OPERATOR LAYOUT)
PROJECT:
ARCHITECT:
CONTRACTOR:
DISTRIBUTOR:
PLANT:
DRAWN BY: _____ DATE: _____
APPROVED BY: _____ DATE: _____
DWG NO. _____ SHT ____ OF ____
ENG. CERT. NO. _____